

## WM-NLC Series

### Use & Care Manual

#### 1. GENERAL INFORMATION

WM-NLC lead-free water meters use the internationally accepted multijet principle. A gear train drives the register totalizer dials. This meter is also available with pulse output (see pulse output details).

#### 2. SPECIFICATIONS

**Temperature:** 122° F maximum

**Pressure:** 150 PSI operating maximum

**Materials:**

Body & Couplings: EcoBrass  
Internals: Engineered thermoplastic  
Magnet: Alnico

**Accuracy:** ± 1.5% (within normal flow rates)

**Sensor:** Reed switch

**Pulse Rates:**

050, 075 & 100: 1 pulse/1 gal.  
150 & 200: 1 pulse/10 gal.

**Maximum Current:** 10 mA

**Maximum Voltage:** 24 VDC/VAC

**Cable Length:** 5' standard  
(2,000' maximum run)




#### 3. METER INSTALLATION

1. Thoroughly flush the service line upstream of the meter to remove dirt and debris.
2. Set the meter inline. Water meters are recommended to be installed horizontally with the register facing upwards.
3. Make sure the water flow follows the arrow cast on the meter body.
4. Slowly open any upstream valves to prevent damage to the meter.


## 4. TECHNICAL DATA

Model No.	Size	Flow Rate (GPM)			Normal Flow (GPM)
		High	Continuous	Low	
WM-NLC-050	5/8" x 1/2"	20	10	0.25	1-20
WM-NLC-075	5/8" x 3/4"	20	10	0.25	1-20
WM-NLC-100	1"	50	25	0.75	3-50
WM-NLC-150	1-1/2"	100	50	1.50	5-100
WM-NLC-200	2"	160	80	2.00	8-160

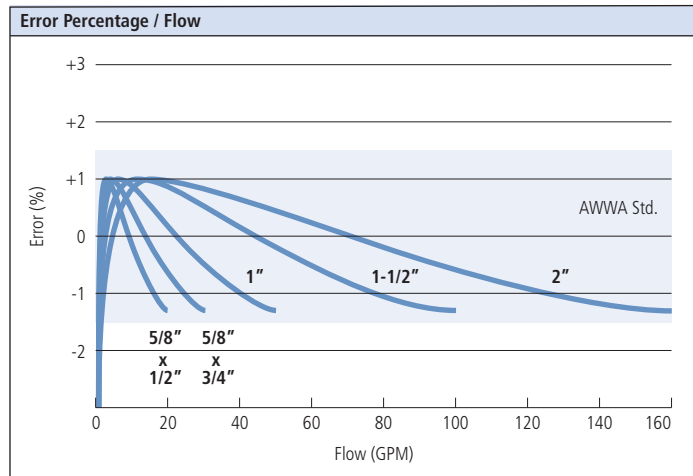

## 5. ACCURACY CURVES

## 6. HEAD LOSS CURVES

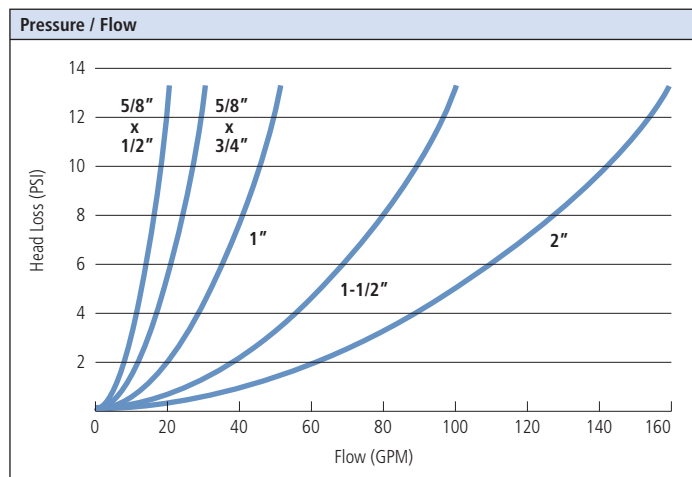


## 7. CALIBRATION

New meters are factory tested to meet the AWWA C-708 multijet meter accuracy specification.


## 8. READING THE DIAL

Sizes 1/2", 3/4", & 1":

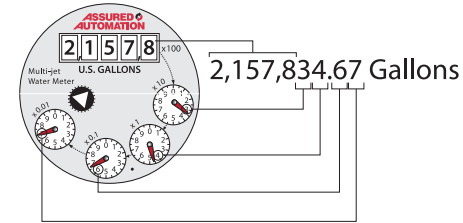

1. To read the meter, start with the register dials (21578).
2. Then add a single digit from each of the dials going in a clockwise direction and rounding each down (3, 4, 6, 7).

Sizes 1-1/2" & 2":

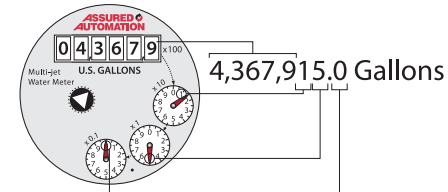

1. To read the meter, start with the register dials (43679).
2. Then add a single digit from each of the dials going in a clockwise direction and rounding each down (1, 5, 0).

## 9. PULSE OUTPUT

The magnet that is connected to a rotating dial on the face of the meter is detected by the Reed Switch sensor installed on the meter lens. Each time the magnet passes under the sensor, it turns on and off, which creates a pulse. The switch is a dry contact closure and does not require any power. Sensors are made for electronic control loads and should not be used to switch power loads or line voltages. Adherence to maximum current and voltage ratings is vital. This data can be found under the Specifications heading.

## 10. INLET STRAINER

Clean the strainer yearly, or as required, depending on water condition. Pull out the strainer or back-flush the meter to loosen trapped particulates.

## 11. WARRANTY

WM-NLC water meters are warranted to perform to AWWA new meter accuracy standards, and for twelve months from the shipment date will be free from defects in materials and workmanship. If a meter fails to perform as warranted, Assured Automation will repair it free of charge subject to the terms of this warranty.

Assured Automation's liability under this performance warranty is expressly limited to the repair or replacement of the meter upon the customer's returning the complete meter prepaid to:

Assured Automation  
19 Walnut Avenue  
Clark, NJ 07066

This performance guarantee is not applicable to meters which have been damaged by aggressive water conditions, foreign matter in media, misapplication, willful misconduct, negligence, vandalism, act of God, improper installation, frost/freeze damage or using the meter outside of its specific operating parameters (especially temperature and flow ranges).

In no event shall Assured Automation be liable for incidental or consequential damages of any kind, including but not limited to loss of profits or revenue, loss of use, cost of capital, cost of substitute equipment, facilities or services, downtime costs, delays and claims of customers of the customer or other third parties.